


MATCHLINE SHEET C8



NOTE: THE WATER TREATMENT PLANT WITH A CAPACITY OF 9 MGD IS LOCATED IN THE CITY OF INGLETSIDE APPROXIMATELY 12 MILES SOUTHEAST OF ROCKPORT

MATCHLINE SHEET D7

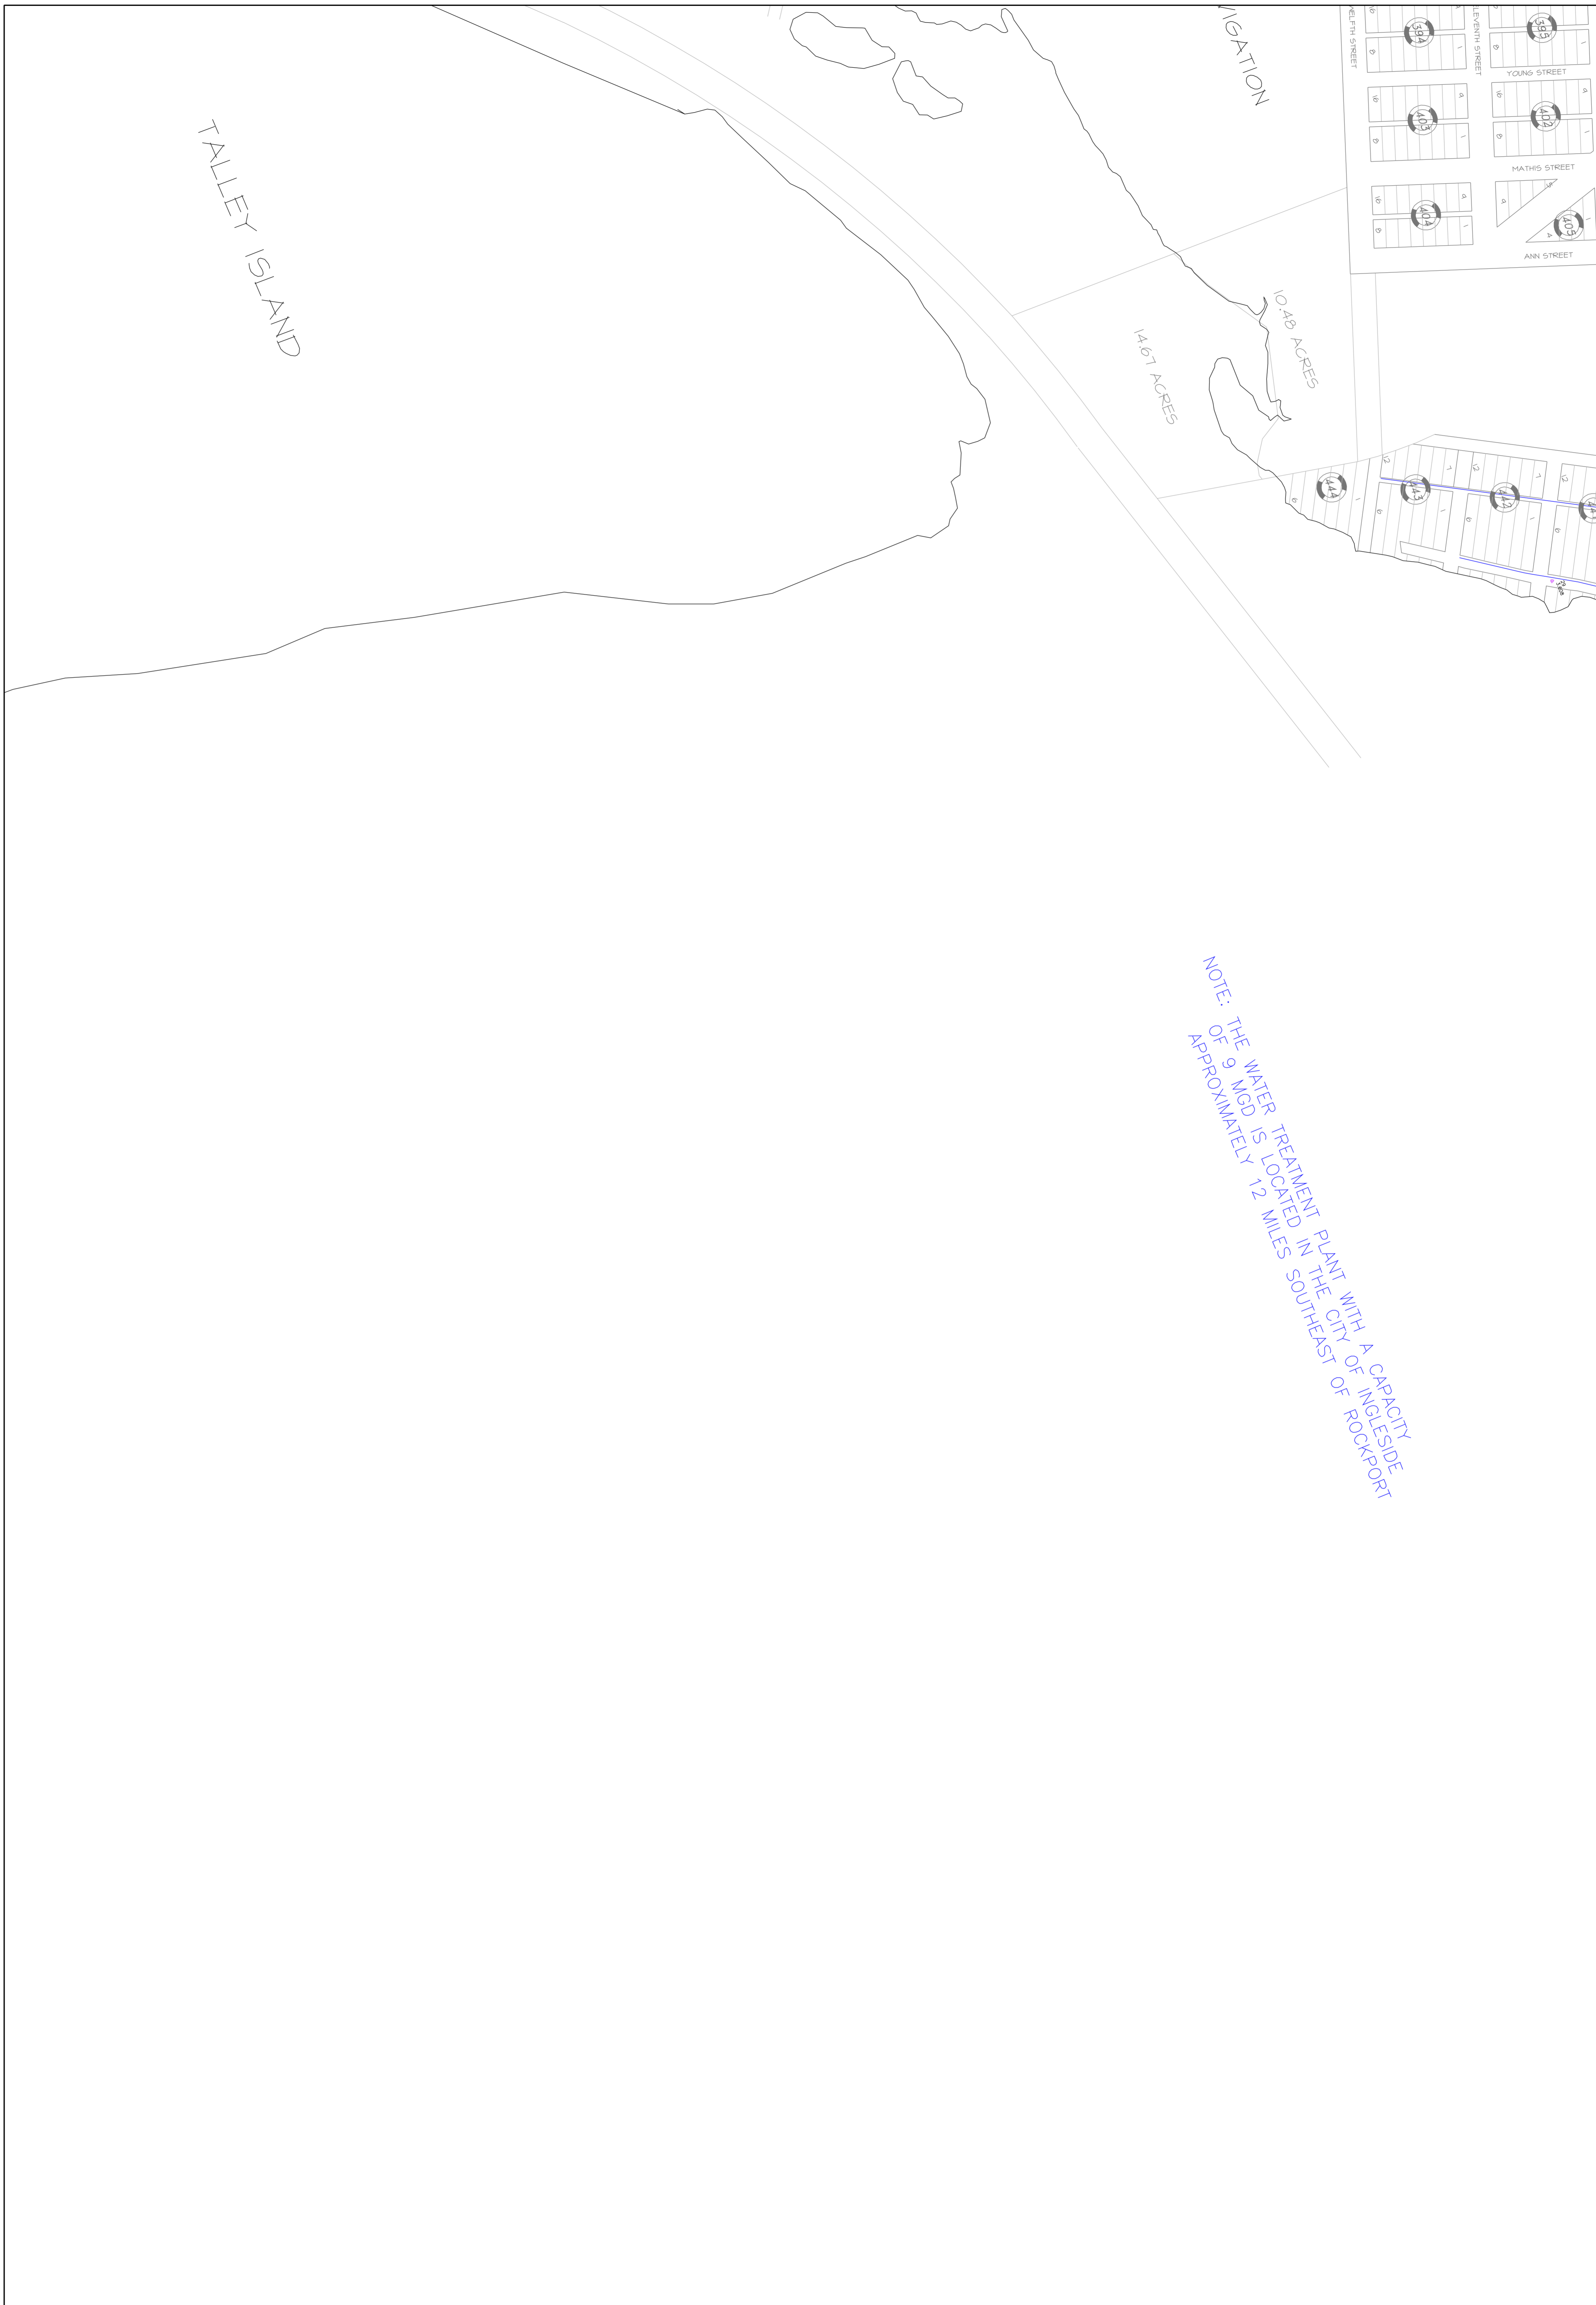

JOB NO. 01560.99.04

URBAN ENGINEERING
CORPUS CHRISTI, TEXAS
2725 SWANTNER P.O. BOX 6355, CORPUS CHRISTI, TX 78466-6355,
(361)854-3101 FAX (361)854-6001

A1	B1	C1	D1
A2	B2	C2	D2
A3	B3	C3	D3
A4	B4	C4	D4
A5	B5	C5	D5
A6	B6	C6	D6
A7	B7	C7	D7
A8	B8	C8	D8
A9	B9	C9	D9
A10	B10	C10	D10

EXISTING UTILITY SYSTEM

**CITY OF ROCKPORT
PUBLIC WORKS DEPARTMENT**
ARANSAS COUNTY, TEXAS

NOTE:
ALL UTILITIES ILLUSTRATED ON THIS MAP ARE GRAPHICALLY REPRESENTED. THEIR LOCATIONS ARE ESTIMATED AND IN NO WAY SHOULD BE CONSIDERED EXACT FOR CONSTRUCTION PURPOSES. THESE MAPS ARE SUBJECT TO CHANGE FOLLOWING NEW CONSTRUCTION, CORRECTIONS AND PERIODIC UPDATES

SCALE: 1"=300'
DRAWN: APL
CHECKED: BLB
DATE: JULY, 2000

APPROVED: JUNE 30, 2000

SHEET **D8**